
ME-AGS wiring diagram – For Generac (Air-cooled, Automatic Standby Generators)

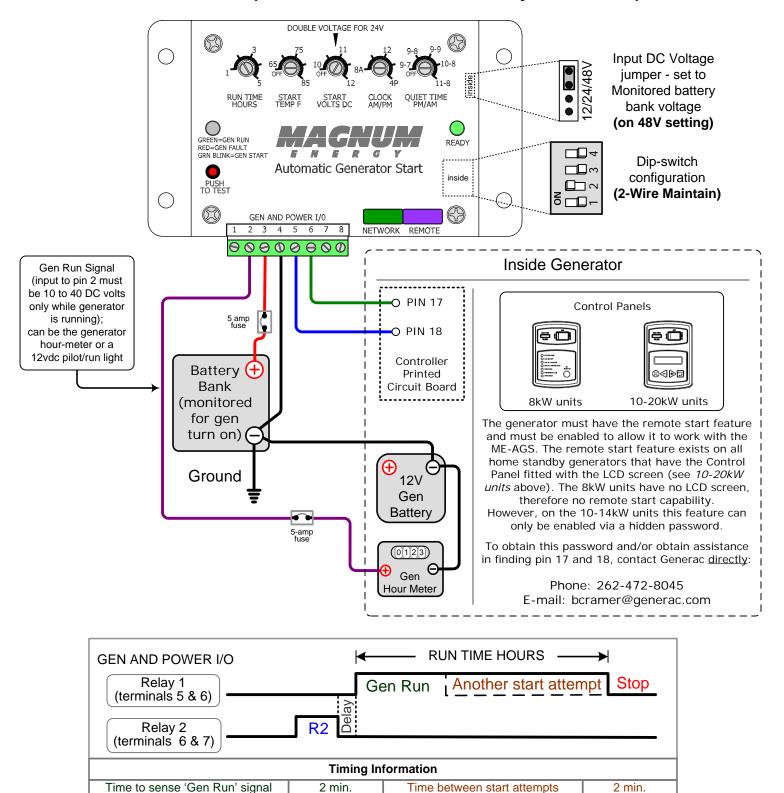

Magnum Energy, Inc. provides this diagram to assist in the installation of the Auto-Generator Start controller. Since the use of this diagram and the conditions or methods of installation, operation and use are beyond the control of Magnum Energy, Inc., we do not assume responsibility and expressly disclaim liability for loss, damage or expense arising out of the installation, operation and use of this unit.

2-20-2009

ME-AGS relay timing for 2-Wire Maintain Mode

Total Start attempts

4

10 sec.

4 sec.

R2 (Relay 2) Time

Delay time